



A Guide to the
ANSI/ISEA Z358.1-2014 International Standard
for Emergency Eyewash and Shower Equipment



The ANSI Standard - An Introduction

Hughes Safety Showers leads the market in its compliance structure not only conforming to the American National Standard, ANSI/ISEA Z358.1-2014, but also to European quality standards.

The internationally recognized American National Standard, ANSI/ISEA Z358.1-2014 provides uniform minimum requirements for the performance, use, installation, testing, maintenance and training of emergency safety shower and eyewash equipment.

This summary should act as an overview to assist specifiers in understanding the guidelines. Please consult the complete ANSI/ISEA Z358.1-2014 standard before purchasing or installing emergency safety equipment.

If you need help or advice on meeting current standards, please contact us:

Tel: +1 (866) 312 1652

Email: customer.service@hughes-safety.com





General Considerations

Water Temperature

- Water delivered by the emergency safety equipment should be tepid, between 60-100 °F (16-38°C).

At temperatures above 100°F (38°C) there is the added danger of scalding and increased absorption of harmful chemicals into the skin. Prolonged exposure to water below 60°F (16°C) increases the risk of thermal shock or hypothermia and prevents the casualty using the shower to decontaminate effectively for the full 15 minutes.

Location

- Emergency safety equipment should be installed within 10 seconds reach, and on the same level as a potential hazard.
- They must be situated in a prominent position, clearly visible, well-lit and free from any obstructions.

Water Flow

- Emergency safety showers should deliver a minimum of 20 US gallons (76 liters) per minute of potable water for up to 15 minutes in the required spray pattern.

- Eye/face wash units should deliver 3 US gallons (11.4 liters) per minute for up to 15 minutes to ensure a thorough decontamination.

Operation

- Both emergency safety showers and eyewashes must be designed so that the valves remain open without the use of the operator's hands until intentionally closed.
- The control valve must be simple to operate and go from 'off' to 'on' in 1 second or less.


Maintenance

- Emergency safety equipment must be visually inspected and activated weekly along with an annual service to guarantee reliable and effective operation and conformance with the standard.

Training

- Personnel who may be exposed to hazardous materials should be instructed on the safe and proper use of the emergency safety equipment and be advised of its location.


Emergency Safety Showers - Drench and Tank Showers

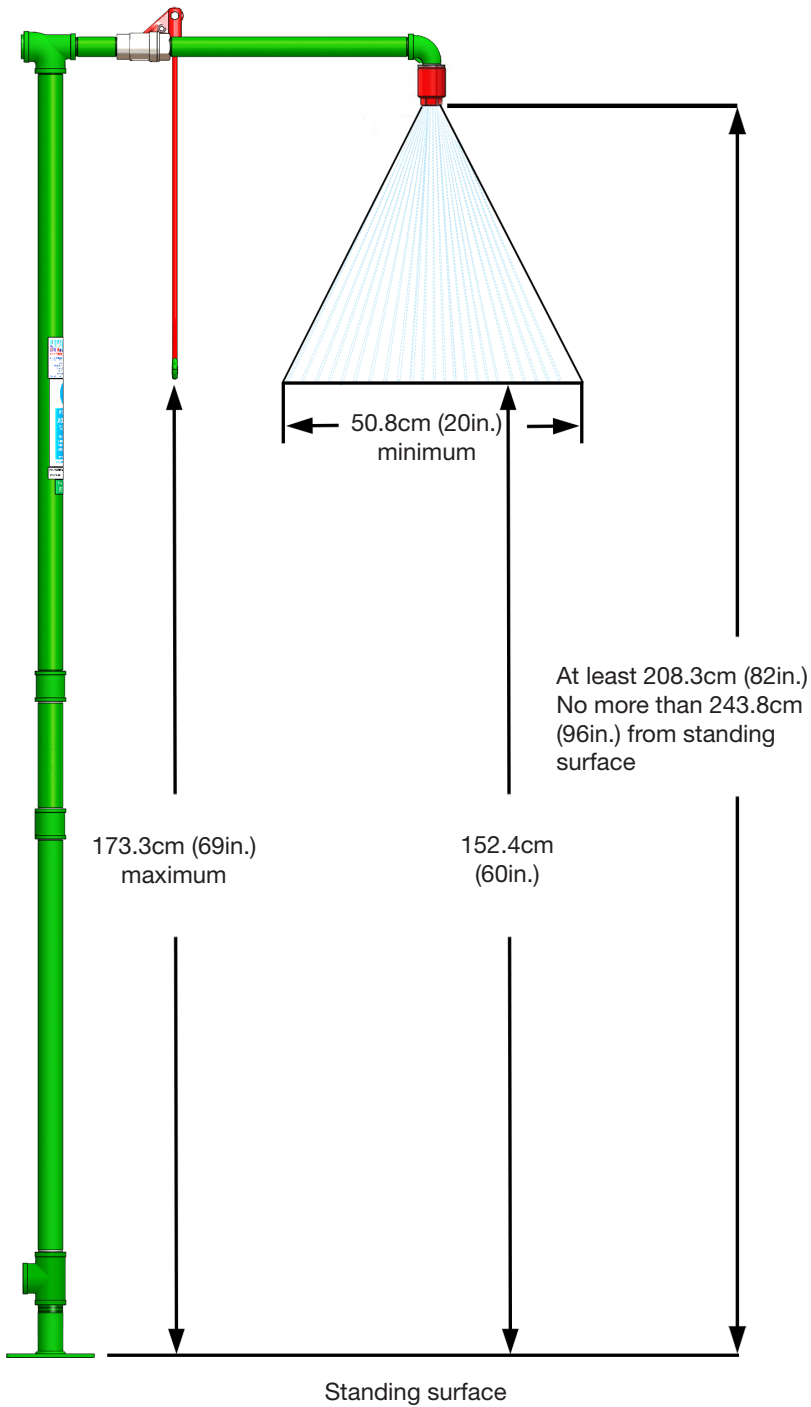

Emergency drench showers shall:

- Deliver tepid water at a minimum of 20 US gallons per minute (76 lpm) for a minimum of 15 minutes in the required pattern. (Section 4.1.2, 4.5.5)
- Provide a spray pattern with a minimum diameter of 50.8cm (20 in) at 152.4cm (60 in) from the floor. (Section 4.4.1, 4.4.2)
- Ensure the center of the spray pattern is located at least 40.6cm (16 in) from any obstruction. (Section 4.1.4, 4.5.4, 4.5.7)
- Provide a flushing column of at least 208.3cm (82 in) and no more than 243.8cm (96 in) from the standing surface. (Section 4.1.3, 4.4.1, 4.5.4)
- The actuation valve should go from 'off' to 'on' in 1 second or less and should not close automatically once opened. (Section 4.1.5, 4.2)
- Incorporate easily located and simple to operate manual or automatic actuators, which should be positioned no more than 173.3cm (69 in) above the floor. (Section 4.1.4, 4.2)


Emergency Safety Showers - Combination

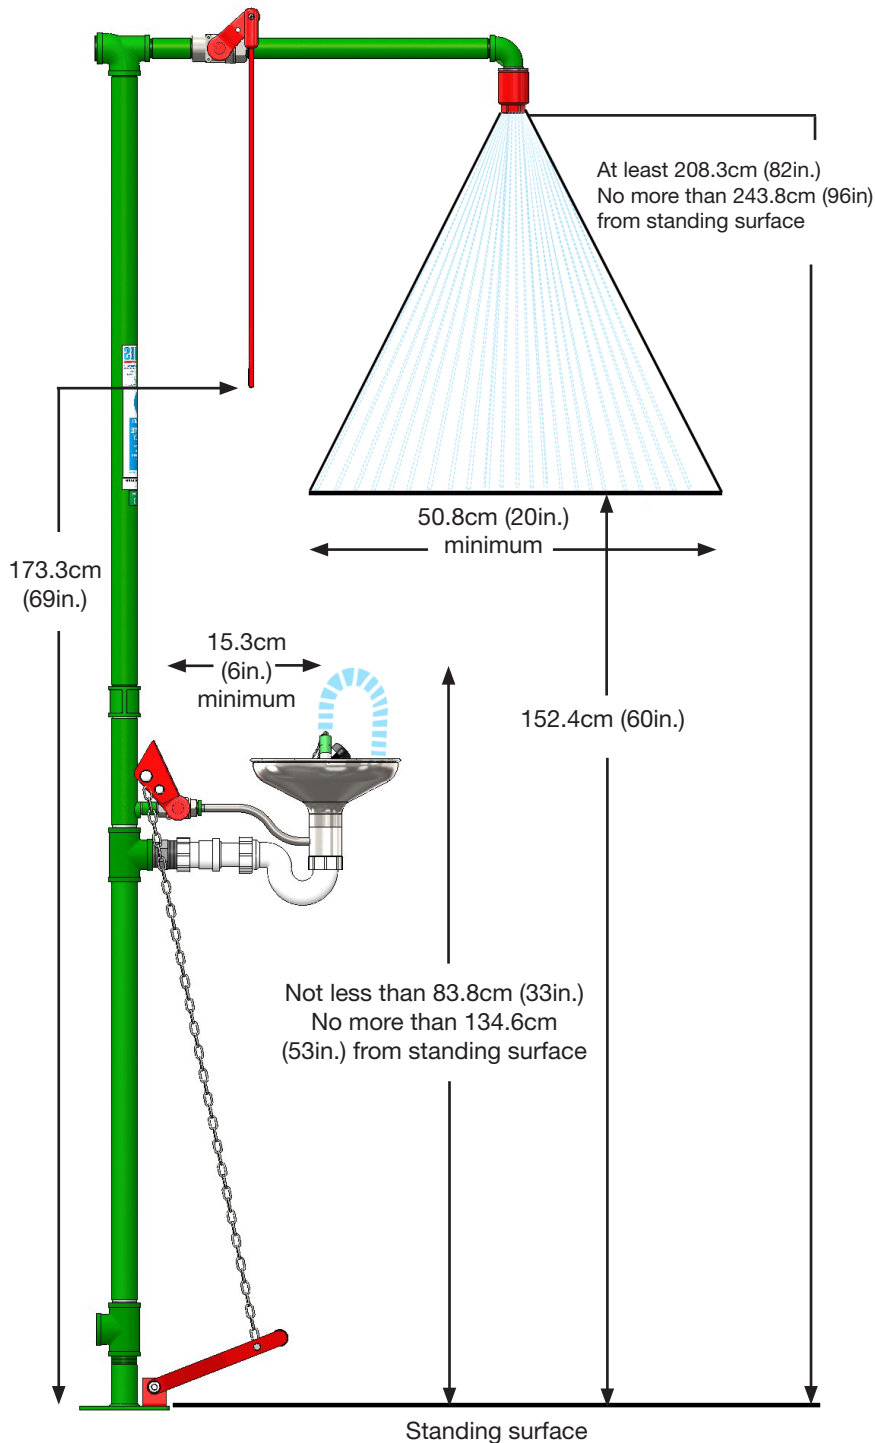

Combination safety showers shall:


- Be designed to allow all components to be used simultaneously by the same user. (Section 7.4.4)
- Ensure the nozzles and eye wash equipment are protected from airborne contaminants. (Section 6.1.3)
- Deliver tepid water from the shower at a minimum of 20 US gallons per minute (76 lpm) for a minimum of 15 minutes in the required pattern. (Section 4.1.2, 4.5.5)
- Deliver flushing fluid to the eyes for not less than 0.4 US gallons per minute (1.5 lpm) for 15 minutes. Eye/face washes should deliver at least 3 US gallons per minute (11.4 lpm) of flushing fluid for 15 minutes. (Section 6.1.6, 6.4.5)
- Provide a spray pattern with a minimum diameter of 50.8cm (20 in) at 152.4cm (60 in) from the standing surface. (Section 4.4.1, 4.4.2)
- Ensure the center of the spray pattern is located at least 40.6cm (16 in) from any obstruction. (Section 4.1.4, 4.5.4, 4.5.7)
- Provide a flushing column of at least 208.3cm (82 in) and no more than 243.8cm (96 in) from the standing surface. (Section 4.1.3, 4.4.1, 4.5.4)
- The actuation valve should go from 'off' to 'on' in 1 second or less and should not close automatically once opened. (Section 4.1.5, 4.2)
- Incorporate easily located and simple to operate manual or automatic actuators, positioned no more than 173.3cm (69 in) above the standing surface. (Section 4.1.4, 4.2)

Emergency Eye/Face Wash Equipment

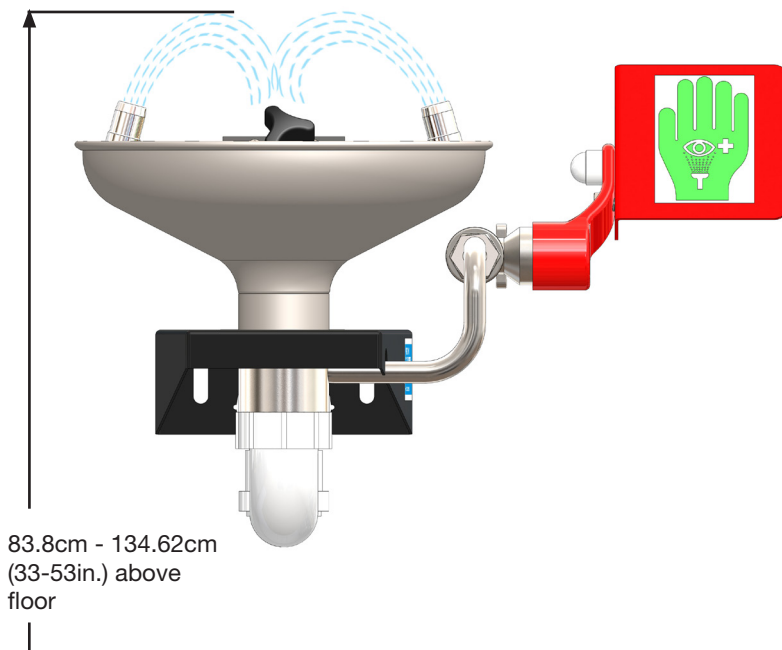

Eye/face wash equipment shall:

- Deliver a controlled flow of tepid water to both eyes simultaneously at a velocity that is non-injurious to the eyes. (Section 6.1.1)
- Eye/face washes should deliver at least 3 US gallons per minute (11.4 lpm) of flushing fluid for 15 minutes. (Section 6.1.6)
- Provide an eyewash pattern positioned between 83.8cm (33 in) and 134.6cm (53 in) from the floor and at least 15.3cm (6 in) from the wall or nearest obstruction. (Section 6.4.4)
- Be designed to ensure the nozzles and eye wash equipment are protected from airborne contaminants. (Section 6.1.3)
- Provide enough space to allow the eyelids to be held open with the hands while the eyes are being rinsed. (Section 6.1.4, 6.1.7)
- The actuation valve should go from 'off' to 'on' in 1 second or less. Simple to operate manual or automatic actuators. (Section 6.1.4, 6.2)

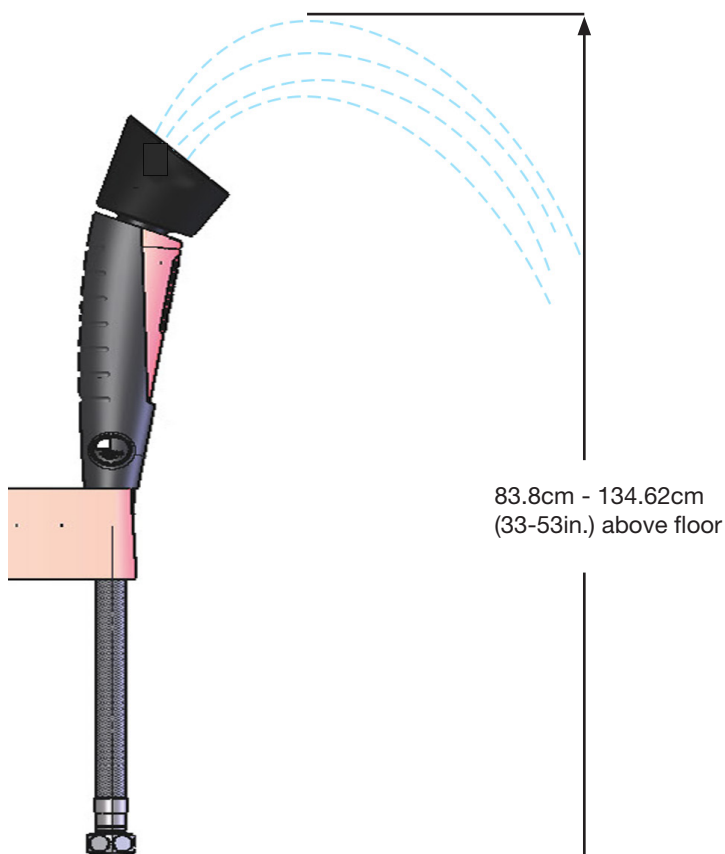



For technical support or advice in meeting the standards contact:

customer.service@hughes-safety.com
+1-(866)-312-1652

For reorder and sales support contact:

custserv@justrite.com
+1-800-798-9250

Hughes Safety Showers North America Inc.
457 Campbell Street, Sarnia, Ontario N7T 2J1, Canada.